

# **IMPROVED ODOUR CONTROL IN THE SEWAGE NETWORK: A CASE STUDY USING BIOSOL IN GRIFFITH NSW**



*Paper Presented by:*

**Steve Oosthuysen**

*Authors:*

**Steve Oosthuysen**, *Water & Sewer Operations Engineer,*  
Griffith City Council

**Nick Chandler**, *BDM,*  
Biosol



*10<sup>th</sup> Annual WIOA  
NSW Water Industry Operations Conference and Exhibition  
Newcastle Jockey Club,  
6 to 7 April, 2016*

# IMPROVED ODOUR CONTROL IN THE SEWAGE NETWORK: A CASE STUDY USING BIOSOL IN GRIFFITH NSW

**Steve Oosthuysen**, *Water & Sewer Operations Engineer*, Griffith City Council  
**Nick Chandler**, *BDM*, Biosol

## ABSTRACT

A paradigm shift in sulfide control in sewers is presented. In January 2014 Biosol was awarded a public tender to treat the total Griffith City Council (GCC) sewer network for odour and corrosion control. By April 2014 the former dosing regime of Magnesium Hydroxide Liquid (MHL) and Ferrous Chloride was decommissioned and Biosol dosing commenced.

This report provides a comparison between the former dosing regime with Biosol across the sewer catchment and the treatment plant. All data in this report has been collected by the GCC (independently of Biosol), although Biosol has been responsible for the presentation of this data.

Biosol has proven in this application to be cost effective, simpler to dose, with superior sulfide control to the products that Biosol displaced. This result has been achieved using non-hazardous chemicals and only one third the comparable product volume.

## 1.0 INTRODUCTION


Sulfide induced infrastructure corrosion in sewer systems is a well-recognised problem for water authorities. Hydrogen sulfide ( $H_2S$ ) is produced under anaerobic conditions by sulfate-reducing bacteria (SRB) which exist in the slime layer (biofilm) that colonise the submerged sections of the pipe. The build-up of  $H_2S$  in the sewer atmosphere causes major detrimental affect such as sewer wall corrosion, health hazards and odour nuisance.

Corrosion occurs as a consequence of sulfuric acid, formed due to the oxidation of  $H_2S$ . This corrosion leads to a reduction in service life of all exposed infrastructure such as concrete pipes, pump stations, manholes and electrical componentry with proportionate rehabilitation costs. In Australia, the cost of asset degradation due to sulfide-induced corrosion is estimated to be in the order of \$100 million per year (Gutierrez, 2011).

Any measure that can be taken to limit the release of  $H_2S$  into the sewer atmosphere will directly result in asset life extension.


### 1.1 The Sewer Sulfide Cycle

Figure 1 eloquently describes the semi-closed biological and chemical cycle of sulfur in the sewer. There are four major segments to the cycle: the generation of sulfide (pathway one), the release of sulfide (pathway two), the conversion of hydrogen sulfide gas to sulfuric acid (pathway three), and reaction of acid on sewer walls (pathway four). Within each segment microbiological and chemical processes occur. These processes are inter-linked and represent the major pathways through which all sulfide processes must pass. At each of the pathways, there exists an opportunity to interfere with the processes and thus reduce or stop the cycle of sulfide generation in sewers.

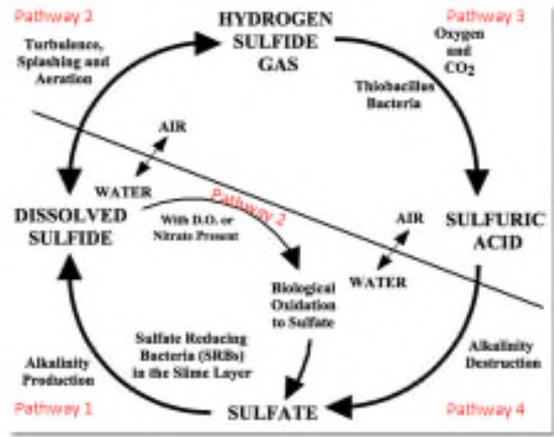

**Figure 1:** *The Sewer Sulfide Cycle (Apgar, 2007)*

Figure 2 further summarises the chemical and biological technologies available to water authorities to mitigate H<sub>2</sub>S emission in sewer systems (modified Zhang, 2008). Each dosing solution has a % below indicating the market penetration of each chemical to overall sulfide control in Australia (Ganigue, 2011).

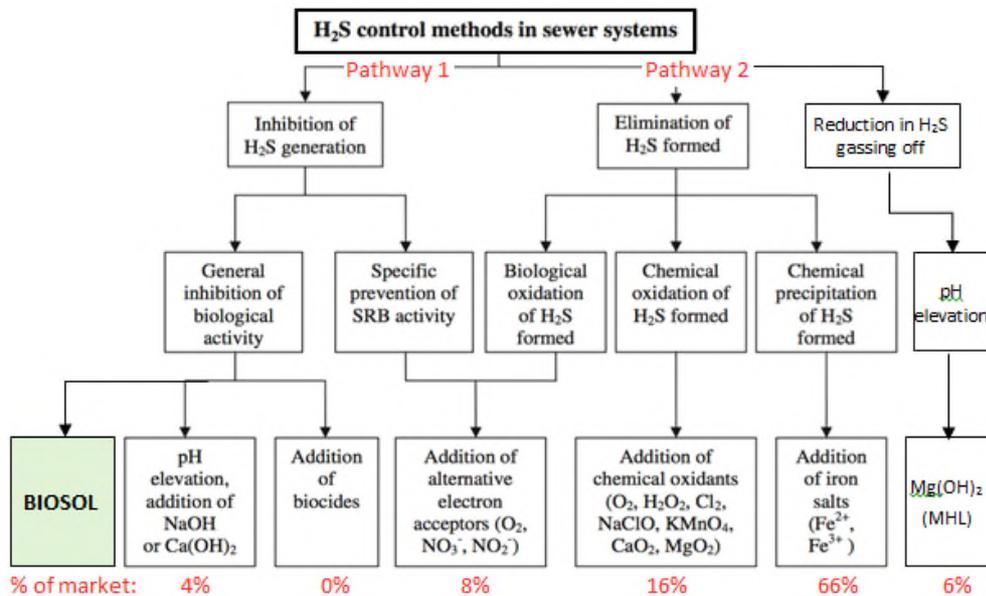

**Figure 2:** *Dosing Technologies for Control of H<sub>2</sub>S Emission & Market Penetration*

The dominant chemical dosing solutions focus on disrupting pathway two – after the problem (sulfide) has already formed. While Biosol is not alone with its focus on disrupting pathway one (the source of the problem), other solutions in this space have significant technical or application issues. Pigging and pH shock for example have brief efficacy windows with SRB rapidly re-establishing post treatment (O’Gorman, 2011 & Gutierrez, 2014). The use of biocides carries inherent risk typically not acceptable to water authorities.

## 1.2 Biosol’s Solution

To describe how Biosol works, it is necessary to provide further background into the slime layer (biofilm) where the SRB inhabit.

Bacteria are highly social organisms that communicate via signalling molecules. They move collectively over surfaces and make biofilm communities. In a biofilm form, bacteria are able to work collectively to exploit a resource. In a sewer, the resource is plentiful. Bacteria in a biofilm will work initially in fresh sewage (where oxygen is available) to decompose simple carbon molecules into carbon dioxide. At some point, oxygen in the sewage will become depleted and the sewage will become anoxic (septic). At the point the sewage becomes anoxic, SRB become active and the sulfide cycle shown in Figure 1 commences.

*Biofilm development* can be divided into three distinct stages (Figure3): attachment of cells to a surface (1), growth of the cells into a sessile biofilm colony (2), and detachment of cells from the colony into the surrounding medium (3).



**Figure 3:** *Biofilm Development & Sloughing (Kaira, 2012)*

Attached cells, prior to the development of a biofilm colony will use a ‘cell-signalling’ mechanism known as ‘quorum sensing’. Quorum sensing bacteria produce and release chemical signal molecules called autoinducers that increase in concentration as a function of cell density (Miller MB, 2001).

In an anoxic sewer, conditions are ideal for SRB. Accordingly SRB will use quorum sensing to coordinate their behaviour by forming (for example) a biofilm where sulphur reduction takes place. The intensity of the activity of the SRB in the biofilm will be a function of the environmental conditions (BOD<sub>5</sub>, temperature, pH & network hydraulics), which will be a function of the concentration of autoinducers.

*Biofilm detachment* by contrast can be divided into two categories: active and passive. Active dispersal refers to mechanisms that are initiated by the bacteria themselves, whereas passive dispersal refers to biofilm cell detachment that is mediated by external forces such as fluid shear, abrasion and human intervention (Kaplan 2010).

In a sewer, the flow of the sewerage in the sewer pipe will have a *passive* dispersal effect of scouring the biofilm. Other methods of passive biofilm dispersal that have been demonstrated to be effective in controlling H<sub>2</sub>S include pigging, pH shock and addition of biocides (O’Gorman, 2011 & Jiang, 2013a).

Biosol’s products by contrast mimic the mechanisms of *active* biofilm dispersal; this is Biosol’s **key point of difference**. Evidence exists in the literature of environmental cues and cell-signals influencing and regulating biofilm dispersal (Kaplan 2010).

Biosol’s product BRX-2DE is manufactured using a proprietary blend of signal blocking chemicals, collectively called CSC’s in the Biosol patent (Chandler, 2009).


These CSC's disrupt quorum sensing (the normal communication signalling between the bacteria) causing biofilm dispersal.

Disrupting / blocking quorum sensing prevents the bacteria from maintaining the biofilm. As a consequence, the biofilm disperses. Since sewage odour and methane gas are generated in the biofilm (slimes) complex in sewers, the removal of the biofilm eradicates the cause of sewage odour and thus corrosion.

Biosol utilise a double dosing strategy with two distinct products, BRX-1CN and BRX-2DE. The BRX-2DE product is non-hazardous and is designed to cause a dispersal of SRB biofilms. The effect of BRX-2DE has been found through field research to be enhanced by the addition of nitrite administered using BRX-1CN. Biosol's synergistic use of nitrite is consistent with what has been found in the literature with nitrite being demonstrated to work synergistically with biocides (Greene, 2006; Jiang, 2013b).

## 2.0 DISCUSSION


Figure 4 shows a simplified schematic of the GCC network; sewage pump station G3 and G4 handle 90% of the sewage flow to the treatment plant.

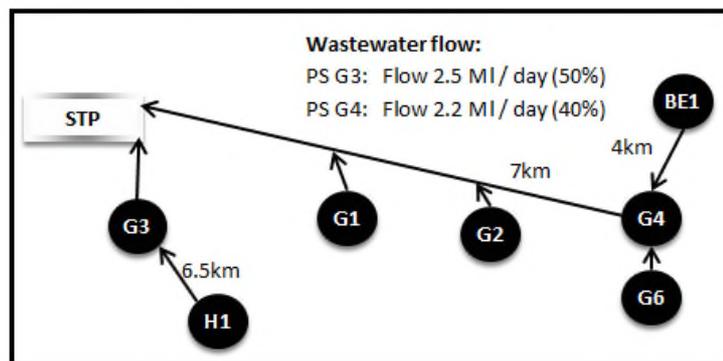


**Figure 4:** *Simplified Schematic of the Griffith Sewer System & Approximate Daily Flow*

The former dosing regime GCC employed is considered an industry leading solution. Othman, 2011 investigated the effect of several chemicals on prohibition of H<sub>2</sub>S generation in sewage. They found the most cost effective combination was an admixture of ferric chloride and MHL. This combination could suppress H<sub>2</sub>S by greater than 95%. Othman's findings are consistent with the findings of (Firer, 2008) who found that shifting pH from 6.5 to 7.5 increased the efficiency of iron sulfide (FeS) precipitation from 55% to 90%.

The G3 data ( Figure ), demonstrates a 90% reduction in H<sub>2</sub>S compared to the previous dosing strategy. In the case of G4 ( Figure ), average H<sub>2</sub>S data from eleven consecutive months in 2009 / 2010 was compared to the same months in 2014 / 2015 demonstrating an 11% reduction in H<sub>2</sub>S at G4. All of the results presented below are comparisons of Biosol to MHL and ferrous chloride dosing.

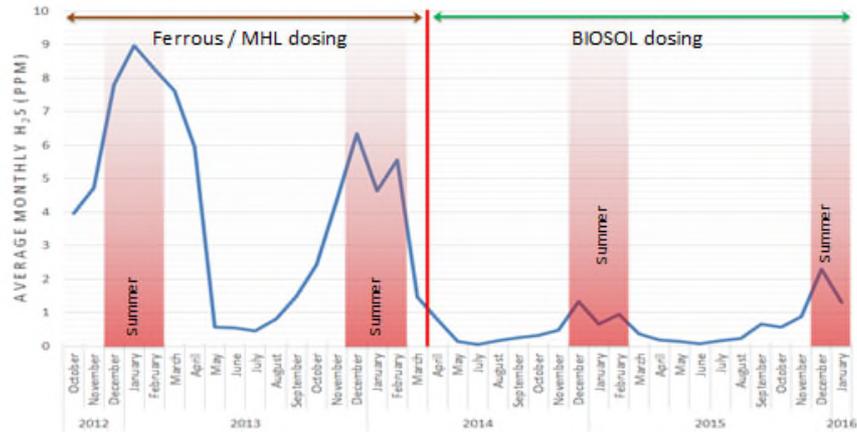

**Figure 5:** *Monthly Average Gas Phase H<sub>2</sub>S as Measured at SPS G3*

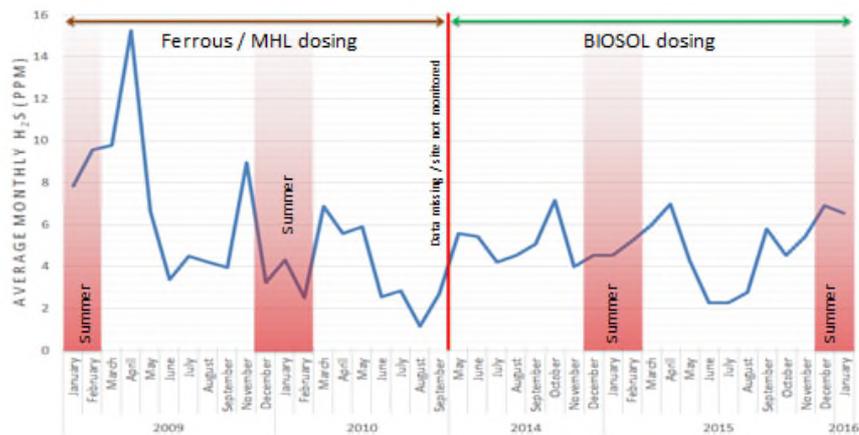

**Figure 6:** *Monthly Average Gas Phase H<sub>2</sub>S as Measured at SPS G4*

Analysis of the factors affecting hydrogen sulfide generation (as identified by Park, 2014) shows influent BOD<sub>5</sub> and temperature have followed a very similar pattern both before and after Biosol commenced dosing. Influent pH at the head of works decreased a little as would be expected with the cessation of MHL dosing. Sewer hydraulics in terms of influent flow to the treatment plant has been consistent however the council has experienced a valve failure on the G4 line, causing a 50% increase in retention time in the G4 main. The failure occurred in June 2015 and since that time, H<sub>2</sub>S at the treatment plant is no longer comparable with the previous data. Prior to this date, Inlet Works data demonstrated a very similar result to that achieved under the former dosing regime.

Since Biosol's dosing infrastructure requirements are 65% less than that of the former dosing regime, the existing dosing infrastructure in place was predominately oversized for Biosol's requirements. Minimal capital outlay by GCC was required for Biosol's implementation.

### 3.0 CONCLUSION

Through the application of BRX-1CN and BRX-2DE in Griffith, Biosol have demonstrated:

- Reduced dissolved sulfide
- Reduced hydrogen sulfide emissions
- Reduced corrosion costs, delaying capital works and maintenance

- Reduced operator and management risk in handling hazardous materials
- No adverse impact on sewage treatment

Globally, the traditional chemical dosing market to address sulfides in sewage is technically mature. Solutions in this space have only evolved incrementally over the past decades. Biosol's approach offers a step change in the way sulfides are managed in sewers.

Through Biosol's application at Griffith, the theoretical chemistry underpinning the products has been validated. Biosol's products have demonstrated that they are not only in line with market leaders but have also demonstrated to outperform them. With further research there is scope to refine and improve Biosol's products and further demonstrate Biosol's technical superiority.

#### 4.0 REFERENCES

- Apgar PD, Witherspoon J 2007. "Minimization of Odors and Corrosion in Collection Systems". Phase 1. Water Environment Research Foundation (WERF). IWA Publishing, London, United Kingdom.
- Chandler, R. 2009, Organic waste treatment, US Patent 7473363
- Firet, D., Friedler, E., and Lahav, O. (2008). "Control of sulfide in sewer systems by dosage of iron salts: Comparison between theoretical and experimental results, and practical implications." *Sci. Total Environ.*, 392(1), 145–156.
- Ganigue, R., Gutierrez, O., Rootsey, R., Yuan, Z., 2011. Chemical dosing for sulfide control in Australia: an industry survey. *Water Res.* 45 (19), 6564-6574.
- Greene, E. A., Brunelle, V., Jenneman, G., Voordouw, G., (2006) "Synergistic Inhibition of Microbial Sulfide Production by Combinations of the Metabolic Inhibitor Nitrite and Biocides" *Applied And Environmental Microbiology*, Vol. 72, No. 12, p. 7897–7901
- Gutierrez, O. 2011. "SCORE-CT: a new method for testing effectiveness of sulfide-control chemicals used in sewer systems " *Water Science & Technology* 63 (12) 2381-2388
- Gutierrez, O., Sudarjanto, G., Ren, G., Ganigue, R., Jiang, G., Yuan, Z., 2014. Assessment of pH shock as a method for controlling sulfide and methane formation in pressure main sewer systems. *Water Res.* 48, 569-578.
- Jiang, G., Keating, A., Corrie, S., O'Halloran, K., Nguyen, L., Yuan, Z. 2013a. "Dosing free nitrous acid for sulfide control in sewers: Results of field trials in Australia" *Water research* 47 (2013) 4331-4339
- Jiang, G., Yuan, Z. 2013b "Synergistic inactivation of anaerobic wastewater biofilm by free nitrous acid and hydrogen peroxide" *Journal of Hazardous Materials* 250–251 (2013) 91–98
- Kaplan JB. Biofilm dispersal: mechanisms, clinical implications, and potential therapeutic uses. *J Dent Res.* 2010; 89:205–218
- Miller MB, Bassler BL. 2001 "Quorum sensing in bacteria" *Annu Rev Microbiol.*; 55:165-99
- O'Gorman, J., Purssell, I., Iori, G. "Caustic soda washing of a sewer pressure main," *Australian Water Association – Water Journal* March 2011, p. 83-87
- Othman, F., MortezaNia, S., Ghafari, S., Hashim, S., 2011. Suppressing dissolved hydrogen sulfide in a sewer network using chemical methods. *Sci. Res. Essays* 6, 3601-3608.
- Park, K., Lee, H., Phelan, S., Liyanaarachchi, S., Marleni, N., Navaratna, D., Jegatheesan, V., Shu, L., 2014. "Mitigation strategies of hydrogen sulphide emission in sewer networks - A review." *Int. Biodeterior. Biodegrad.* 95, 251-261. Part A.
- Zhang, L., De Schryver, P., De Gussem, B., De Muynck, W., Boon N., and Verstraete, W., Chemical and biological technologies for hydrogen sulfide emission control in sewer systems: a review, *Water Res.* 42 (1-2) (2008), pp. 1–12